

January 07, 2008

**ADDENDUM NO. 2
FOR THE CONSTRUCTION OF THE
PAB & PAC BUILDINGS TELECOM CABLING UPGRADES PROJECT**

Notice is hereby given that the following revisions, additions, and/or deletions are hereby made a part of and incorporated into the plans and specifications for the PAB & PAC Buildings Telecom Cabling Project.

NOTICE TO CONTRACTORS – PLANS AND SPECIFICATIONS
REVISION:

1. The **FILING DATE** of **BIDS** has been **EXTENDED** from January 10, 2008 to **January 15, 2008** on or before 3:00 PM.

CLARIFICATIONS: The clarifications section below is provided in response to questions received from prospective bidders within this period.

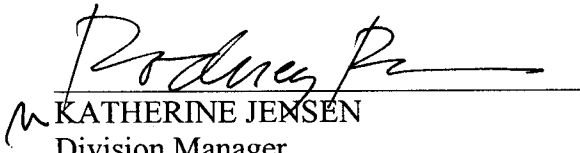
2. There will be a second Voluntary Pre-Bid Meeting held at the north east corner of the PAC Building located at 855 North San Pedro Street in San Jose on **Wednesday January 9, 2008 at 9:00 a.m.**
3. The Bidder's Bond page 14 will not be re-issued Attach addenda to Bid Package as required.
4. This is a design/build project. Contractor is responsible to include a paragraph to require "Asbestos Abatement" process if there is an evidence of "Asbestos" contents revealed during demolition. The cost for the abatement process will be submitted by the contractor as a change order proposal.
5. The **X-Ray Photograph is required** at all Core Drilling locations in this project. Refer to Project Manual page 95, Appendix F, Part 2, Item F.
6. Contractor is responsible for the design and to make all design engineering assessments related to the project including but not limited to field verifications, all load testing, load calculations, voltage drop analysis, and load analysis. Comply with Project Manual page 97, Appendix F, Part 2, Items R and S.
7. The "As Is" electronic AutoCAD *.DWG files that were used to produce the drawing sheets for the bid package will be made available for the Contractor's use and modification if so requested. Contractor is reminded that final completed AutoCAD drawing files are the responsibility of the contractor. Comply with Project Manual page 89-90, Appendix F, Part 1, Items C and F.

8. CAT6 cable runs and SM fiber are required to be in separate conduits and/or sleeves as specified per Project Manual page 95, Appendix F, Part 2, Item C.
9. The contractor is responsible for verification of exact workstation/device quantity and location requirements during design phase per project manual. Refer to Project Manual page 90, Appendix F, Part 1 Item D.
10. Provide PAC SM Fiber as indicated project Contract Document Drawing Sheet E-1.

INSTRUCTIONS

The bidder must sign this addendum in the space provided below and return one signed copy with the bid. Failure to return the signed copy with bid documents shall not relieve the bidder of the obligation to include this addendum to the bid proposal.

APPROVED BY:


KATHERINE JENSEN
Division Manager
City Facilities Architectural Services Division
Department of Public Works

Bidder's Name _____

Signature and Title of Bidder

Date